

# ELEKTROTECHNICKÝ ZKUŠEBNÍ ÚSTAV



ELECTROTECHNICAL TESTING INSTITUTE - CZECH REPUBLIC  
ELEKTROTECHNISCHE PRÜFANSTALT - TSCHHECHISCHE REPUBLIK  
INSTITUT ELECTROTECHNIQUE D'ESSAIS - RÉPUBLIQUE TCHÉQUE  
ЭЛЕКТРОТЕХНИЧЕСКИЙ ИСПЫТАТЕЛЬНЫЙ ИНСТИТУТ - ЧЕШСКАЯ РЕСПУБЛИКА

Pod lísem 129/2, 171 02 Praha 8 - Troja

## CERTIFICATE

No.: 1230062

**Product:** Empty enclosure for distribution boards (steel-plastic)

**Type:** RZA (variants see Annex)

**Rating:** IP30, IK07, Ui 500 V, indoor use

**Ordering firm:** OEZ s.r.o.  
Šedivská 339, 561 51 Letohrad, Czech Republic

**Manufacturer:** OEZ s.r.o.  
Šedivská 339, 561 51 Letohrad, Czech Republic

**Trade mark:**

**The test results are stated in the test-report No.:** 230378-01/01 of: 27.02.2023

**A sample of the product was found to be in conformity with:**  
ČSN EN 62208 ed.2:12  
cl: 4, 6, 9.3, 9.4, 9.7, 9.8, 9.9.1, 9.9.3, 9.10, 9.13, 9.14

**Other data:**

**The validity of the certificate is limited to:** 06.03.2026

07.03.2023

Prague

Mgr. Miroslav Sedláček  
Head of Certification Body



Stamp




230378-01

# Steel-plastic empty enclosure for switchboards - RZA

## Type designation:

Example: RZA-Z-1S14

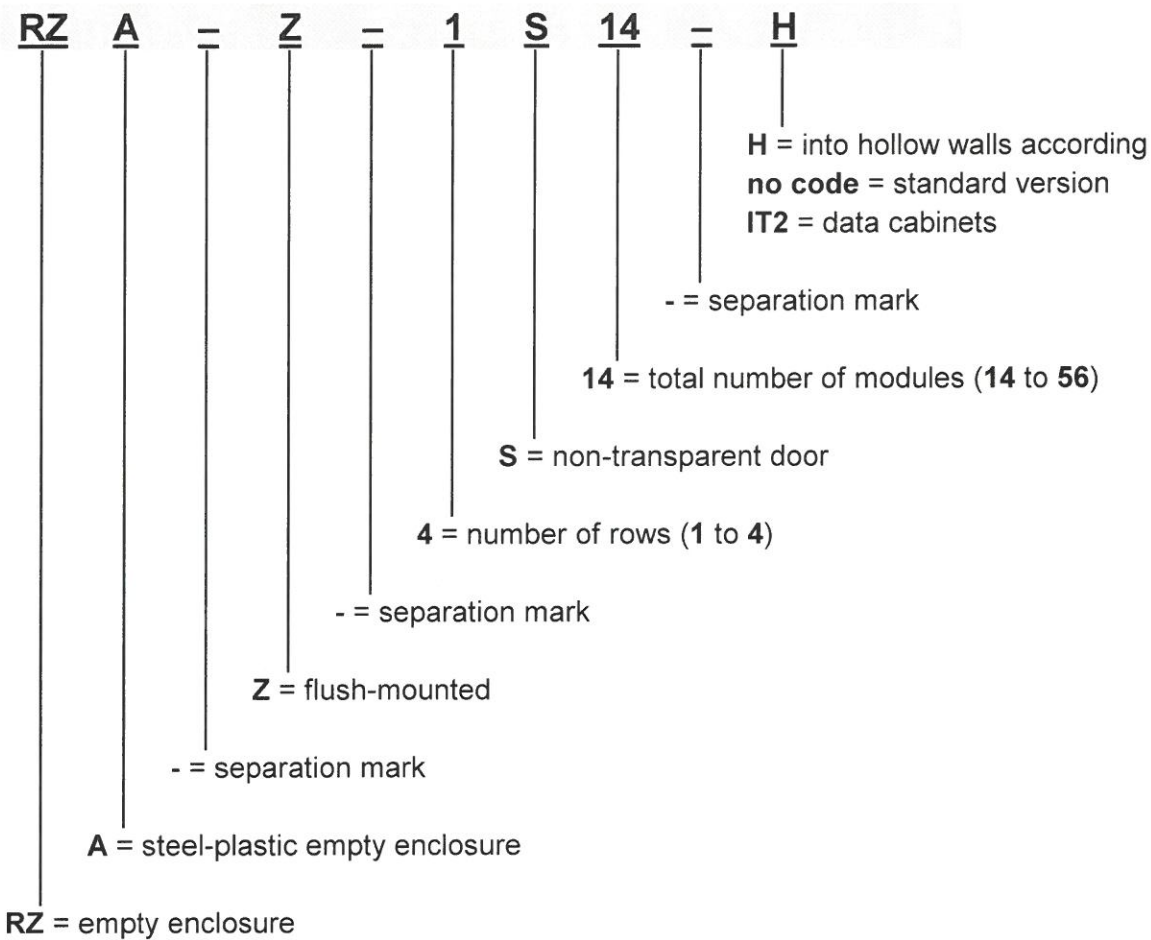

Changing type codes:	
New type designation	Original type designation
RZA-Z-1S14	RZA-1N14
RZA-Z-2S28	RZA-2N28
RZA-Z-3S42	RZA-3N42
RZA-Z-4S56	RZA-4N56
RZA-Z-1S14-H	RZA-1N14-H
RZA-Z-2S28-H	RZA-2N28-H
RZA-Z-3S42-H	RZA-3N42-H
RZA-Z-4S56-H	RZA-4N56-H
RZA-Z-3S14-IT2	RZA-Z-3S14-IT2

